


Scrubbers and Advanced NO_x Controls on TVA's Coal Fired Power Plants

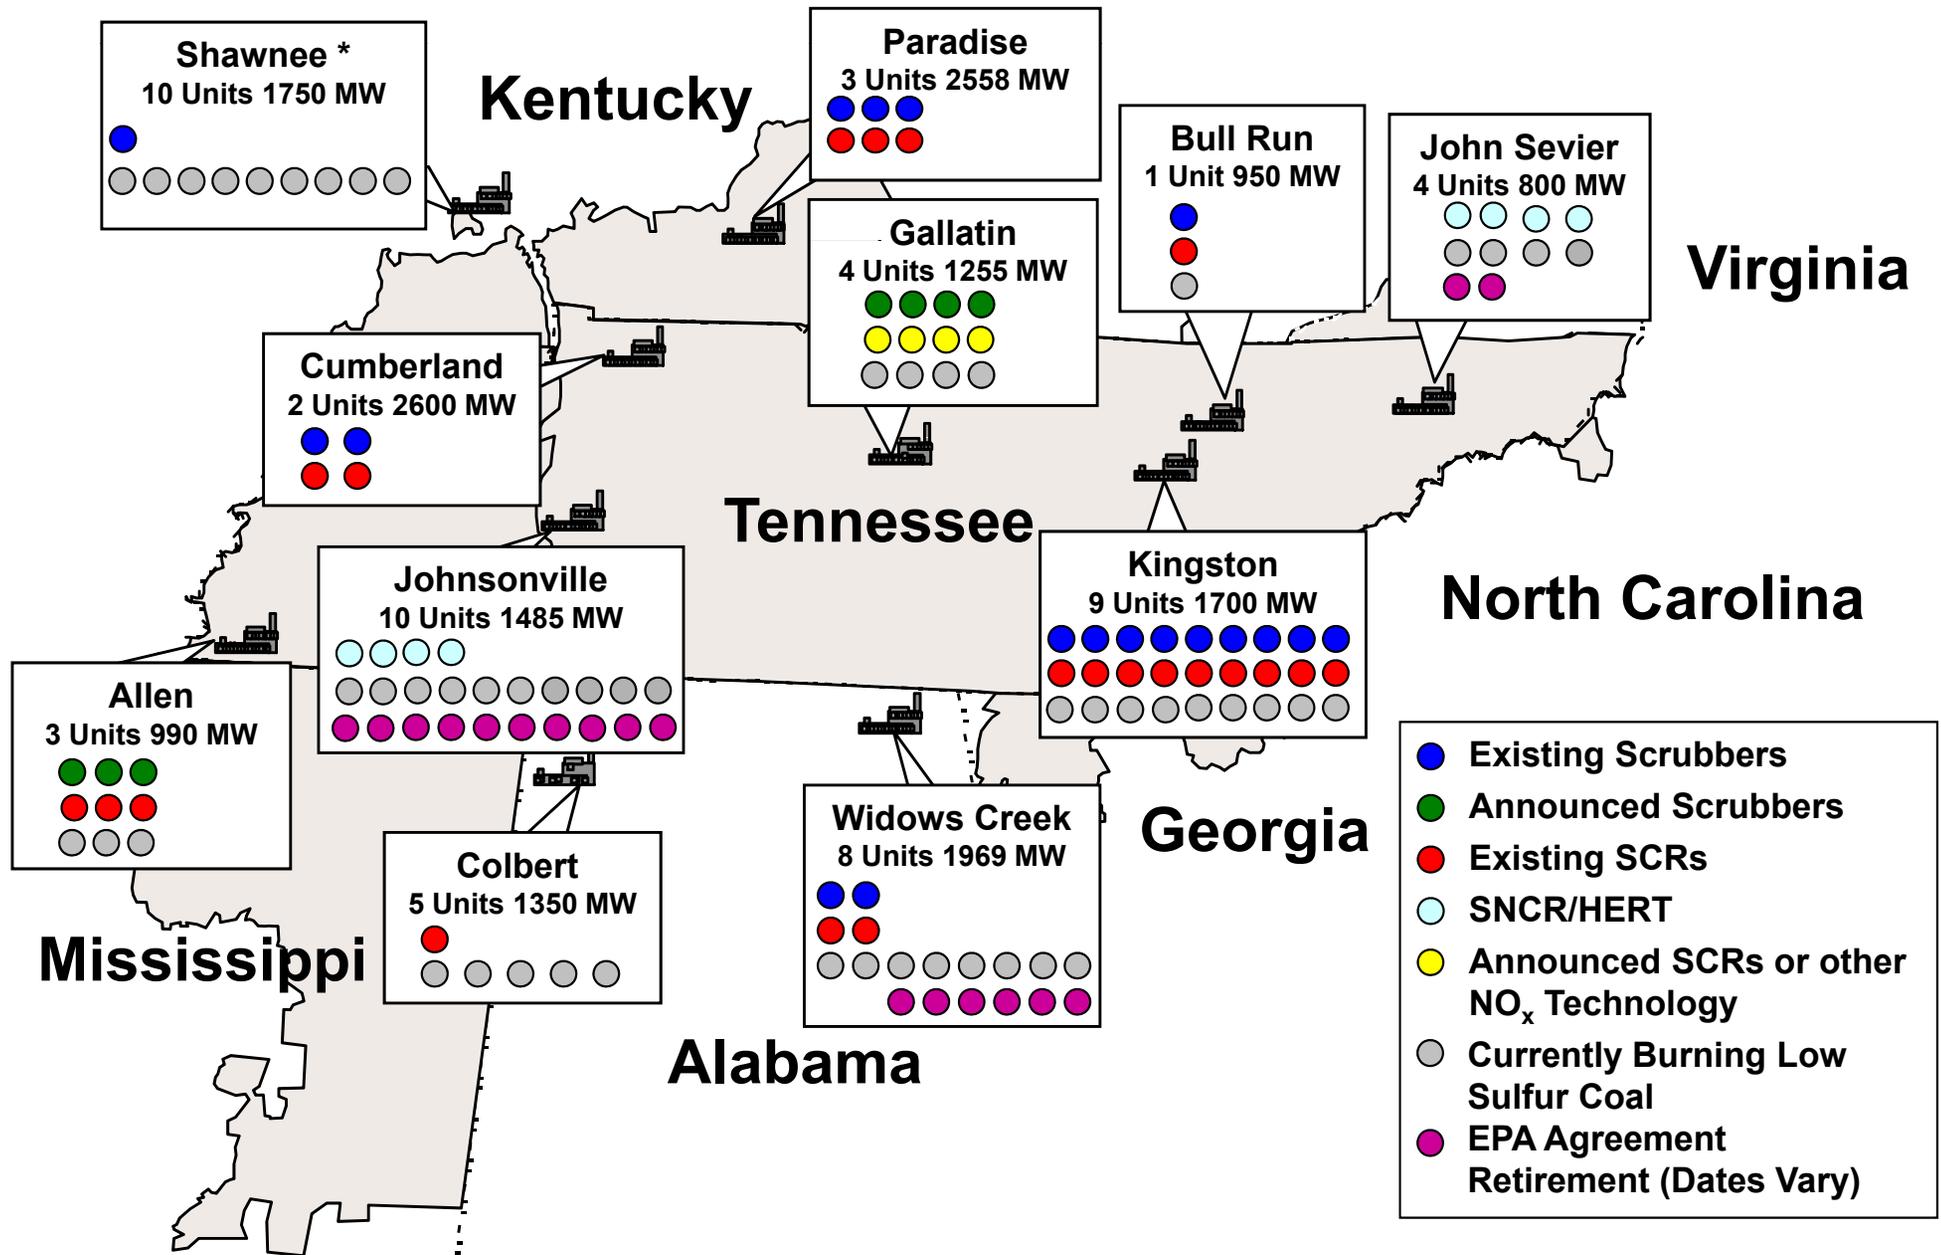

* Shawnee Unit 10 is an Atmospheric Fluidized Bed Combustion (AFBC) boiler which lowers SO₂ and NO_x emissions without the use of external controls.

NOTE: In addition to 21 selective catalytic reduction systems, TVA has installed low NO_x burners or over-fire air on 40 of the 59 coal-fired units. The other units have installed boiler optimization systems and Shawnee Unit 10 is a boiler with low NO_x technology.