



Attachment B – Branch or Ditch Crossing Detail

Page intentionally blank

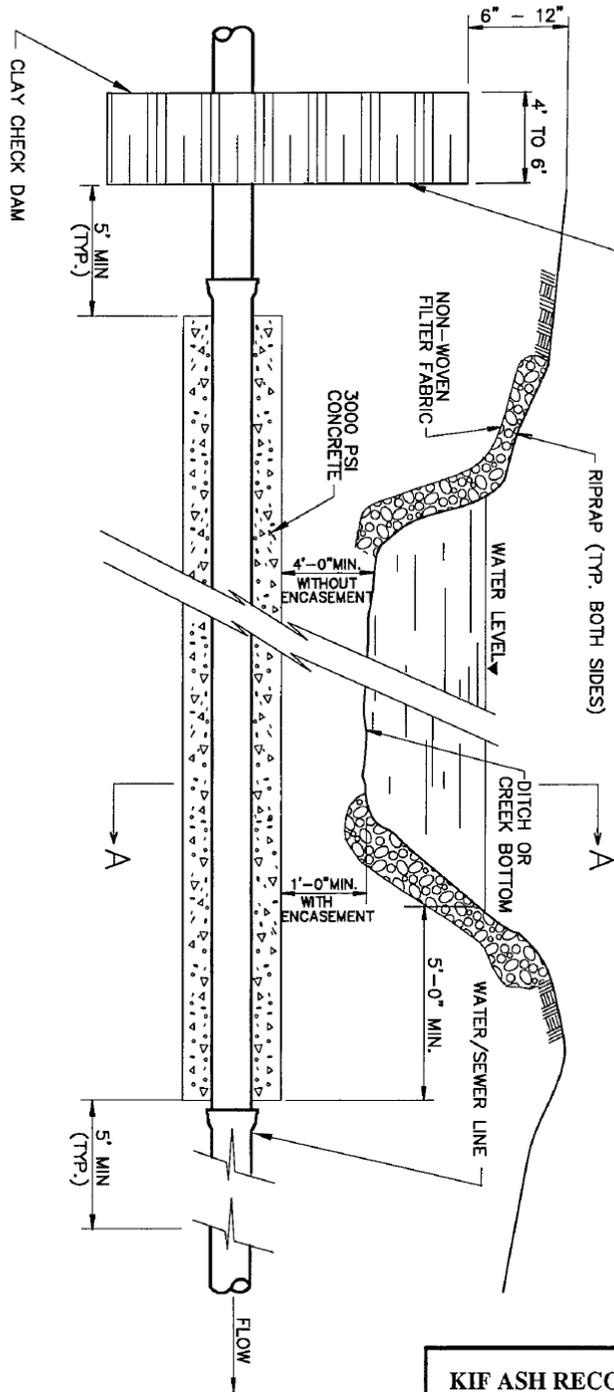

RECD. ON BRANCH CROSSINGS AND/OR WHERE SHOWN ON DRAWINGS. BACKFILL WITH CLAY MATERIAL (NO ORGANIC MATERIAL): FROM 1-FOOT BELOW BOTTOM OF TRENCH TO WITHIN 6-INCHES TO 12-INCHES FROM TOP OF GROUND AND 1-FOOT OUTSIDE EACH SIDE OF TRENCH. (TYPICAL EACH SIDE)

SECTION "A"

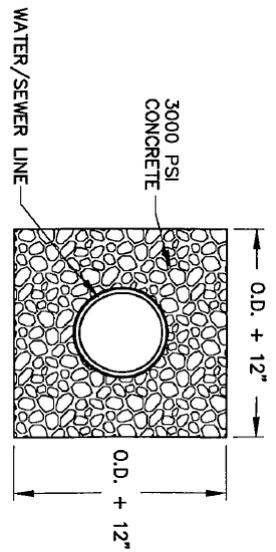

NOTE:
 PROVIDE MIN. 4 FEET OF COVER UNLESS IN ROCK. IF ROCK IS ENCOUNTERED TOP OF PIPE SHALL BE 1 FOOT BELOW ROCK ENCASED IN CONCRETE. PIPING MATERIAL SHALL BE DUCTILE IRON UNLESS OTHERWISE SPECIFIED IN DRAWINGS.

KIF ASH RECOVERY - UTILITY RESTORATIONS AND ENHANCEMENTS

BRANCH OR DITCH CROSSING DETAIL

NOT TO SCALE



TENNESSEE VALLEY
 AUTHORITY

C07070

Page intentionally blank