51840\FIG2-4.DWG PLOT DATE: 10\01\2002

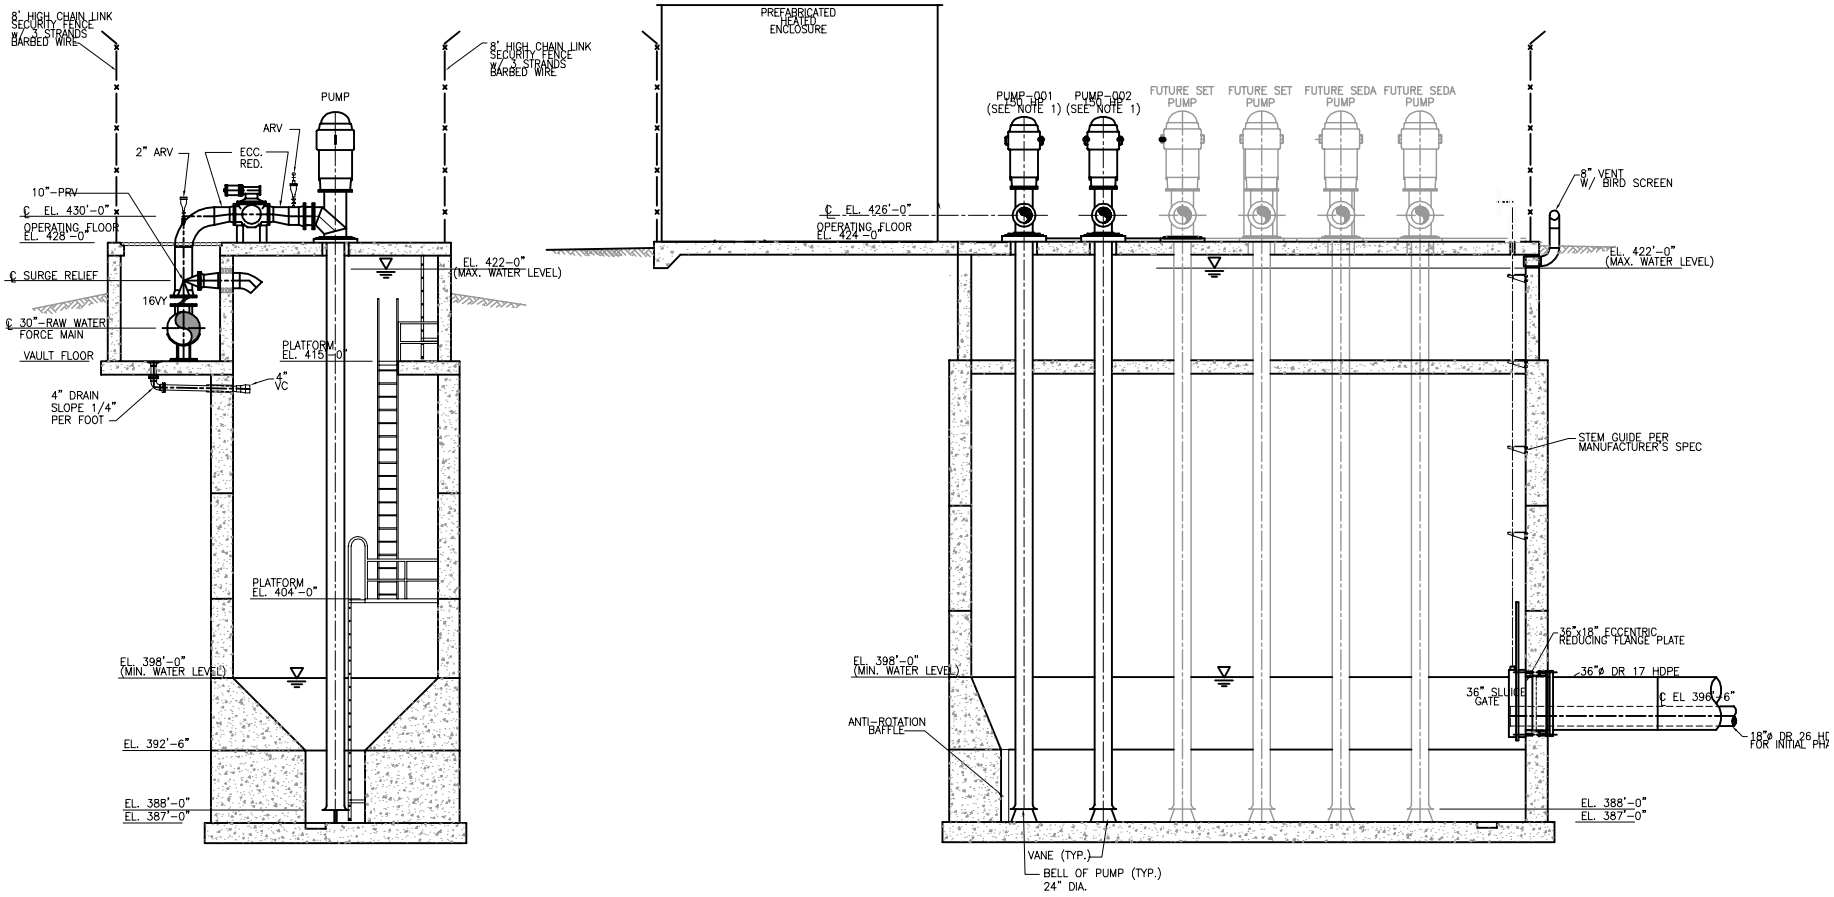

NOTES

1. PUMP SHALL BE 150 HP - 3 STAGE VERTICAL TURBINE PUMP OPERATING AT 1200 RPM. MOTOR TO BE 480V VERTICAL TYPE XT w/ 447T FRAME. MAXIMUM NOISE LEVEL IS 74 DBA @ 3'.

0 4' 8' 12'

EARTH TECH

Figure 2-4

Raw Water Intake
Wetwell Sections

Southeast Tissue Company LLC
Proposed Barton, Alabama Facility
Earth Tech Project No. 51840 September 2002